

Pulp Strength Testing System

Space & Services

Electricity

Three standard receptacles,
120 V / 60 Hz power, 20 Amp.

Water

Filtered (25u) potable water
to the ASF and to the wet
table - standard pressure/flow.

Drain




Low flow from the ASF
and from the sink.

Air

8 CFM at 120 psi.



Typical Set-Ups

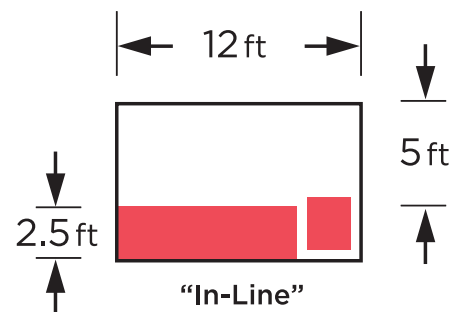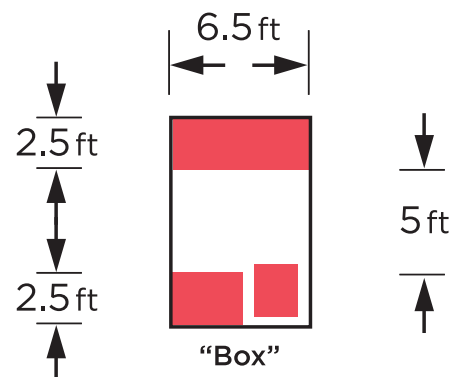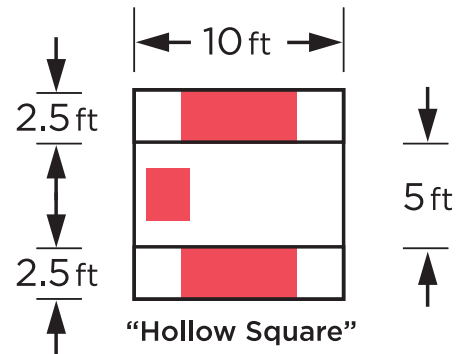

Pulmac Systems International Inc.
35 Dorset Lane, Suite 201
Williston, Vermont
05495 USA

Phone: + 802.223.2663

Fax: + 802.223.2664

Email: info@pulmac.com

URL: www.pulmac.com