

Pulp Strength Testing System

Space & Services

Electricity

Three standard receptacles,
220V / 50 Hz power, 20 Amp.

Water

Filtered (25u) potable water
to the ASF and to the wet
table - standard pressure/flow .

Drain




Low flow from the ASF
and from the sink.

Air

3 l/sec at 8 Bar Pressure.



Typical Set-Ups

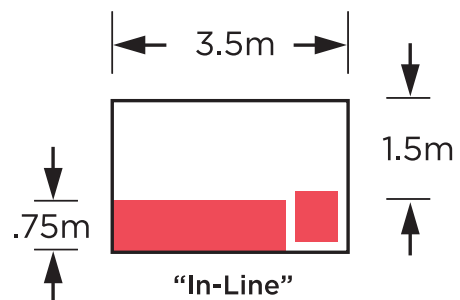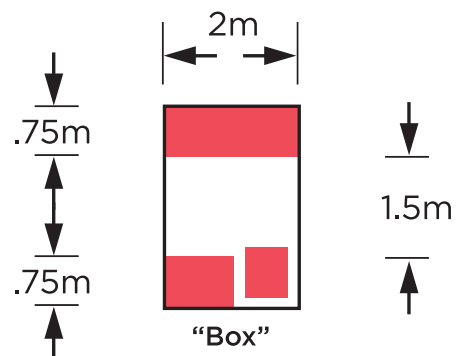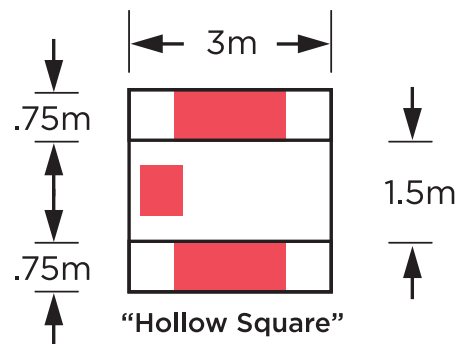

Pulmac Systems International Inc.
35 Dorset Lane, Suite 201
Williston, Vermont
05495 USA

Phone: + 802.223.2663
Fax: + 802.223.2664
Email: info@pulmac.com
URL: www.pulmac.com